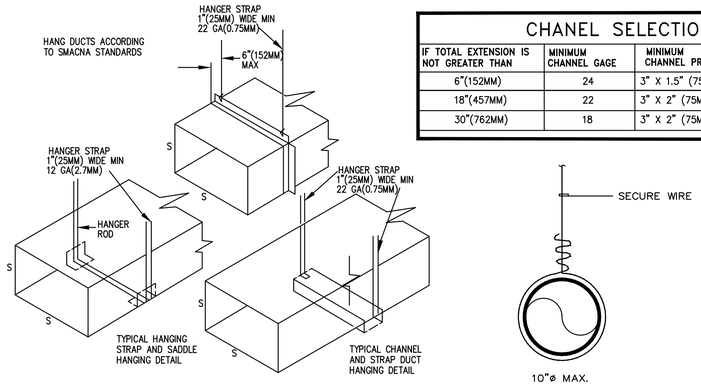

CHANEL SELECTION		
IF TOTAL EXTENSION IS NOT GREATER THAN	MINIMUM CHANNEL GAGE	MINIMUM CHANNEL PROFILE
6"(152MM)	24	3" X 1.5" (75MM X 38mm)
18"(457MM)	22	3" X 2" (75MM X 50mm)
30"(762MM)	18	3" X 2" (75MM X 50mm)

METHODS OF HANGING

N.T.S.

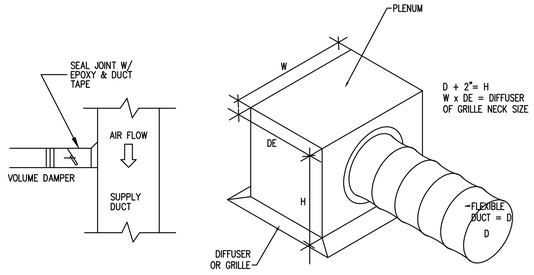

FLEXIBLE DUCT CONNECTION DETAIL

N.T.S.

NOTES:

1.- PROVIDE BACKDRAFT DAMPER W/ BIRDSCREEN
2.- FLASH & SEAL WALL AND ROOF CAP

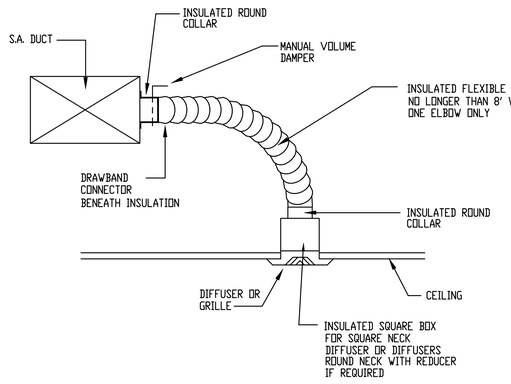

TYPICAL CONNECTION TO AIR DIFFUSER

N.T.S.

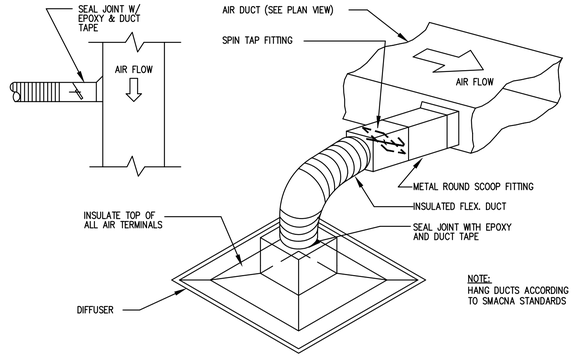

FLEXIBLE DUCT CONNECTION DETAIL

N.T.S.

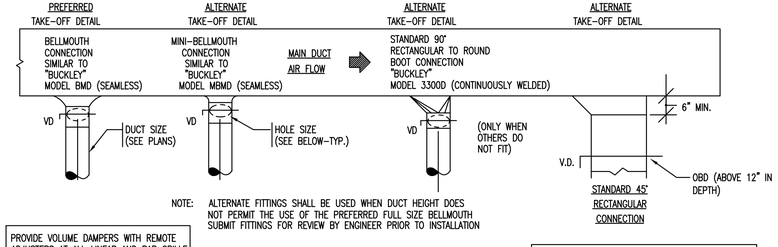

DUCT TAKEOFFS DETAIL

N.T.S.

George Friejo Digitally signed by George Friejo Date: 2024.01.10 10:54:15 -05'00'

Fine Line Engineers Inc.
Electrical, Mechanical, Plumbing
Fire Protection, Construction Administration
2089 W. 76TH STREET Hialeah, FL 33016
Voice: 786.953-4901 - Fax: 786.953-4907
E-mail: cadinfo@flengineers.com
GEORGE FREIJO, P.E.
REGISTERED ENGINEER NO. 32578
STATE OF FLORIDA CA# 29796
©ALL RIGHTS RESERVED
Fine Line Engineering, Inc.

ANA STUDIO ARCHITECTURE, PC
ANA R.ESKREIS,RA
280 RIVERSIDE DRIVE (6E), NEW YORK, N.Y 10025
+1516.641.5416 +33 (0) 45-84-24 55
ANASTUDIO2013@GMAIL.COM
www.FRENCHDIBS.com

WEXLER RESIDENCE
300 SOUTHPOINTE DR.
4304

MIAMI BEACH, FL.
33139

NOTES

No.	Date	Description

TITTLE

SEAL & SIGNATURE:

DATE: 12.12.2023
PROJECT No:
DRAWN BY:
CHECKED BY:
DWG No:

SPACE FOR NYC-ISCAN STICKER